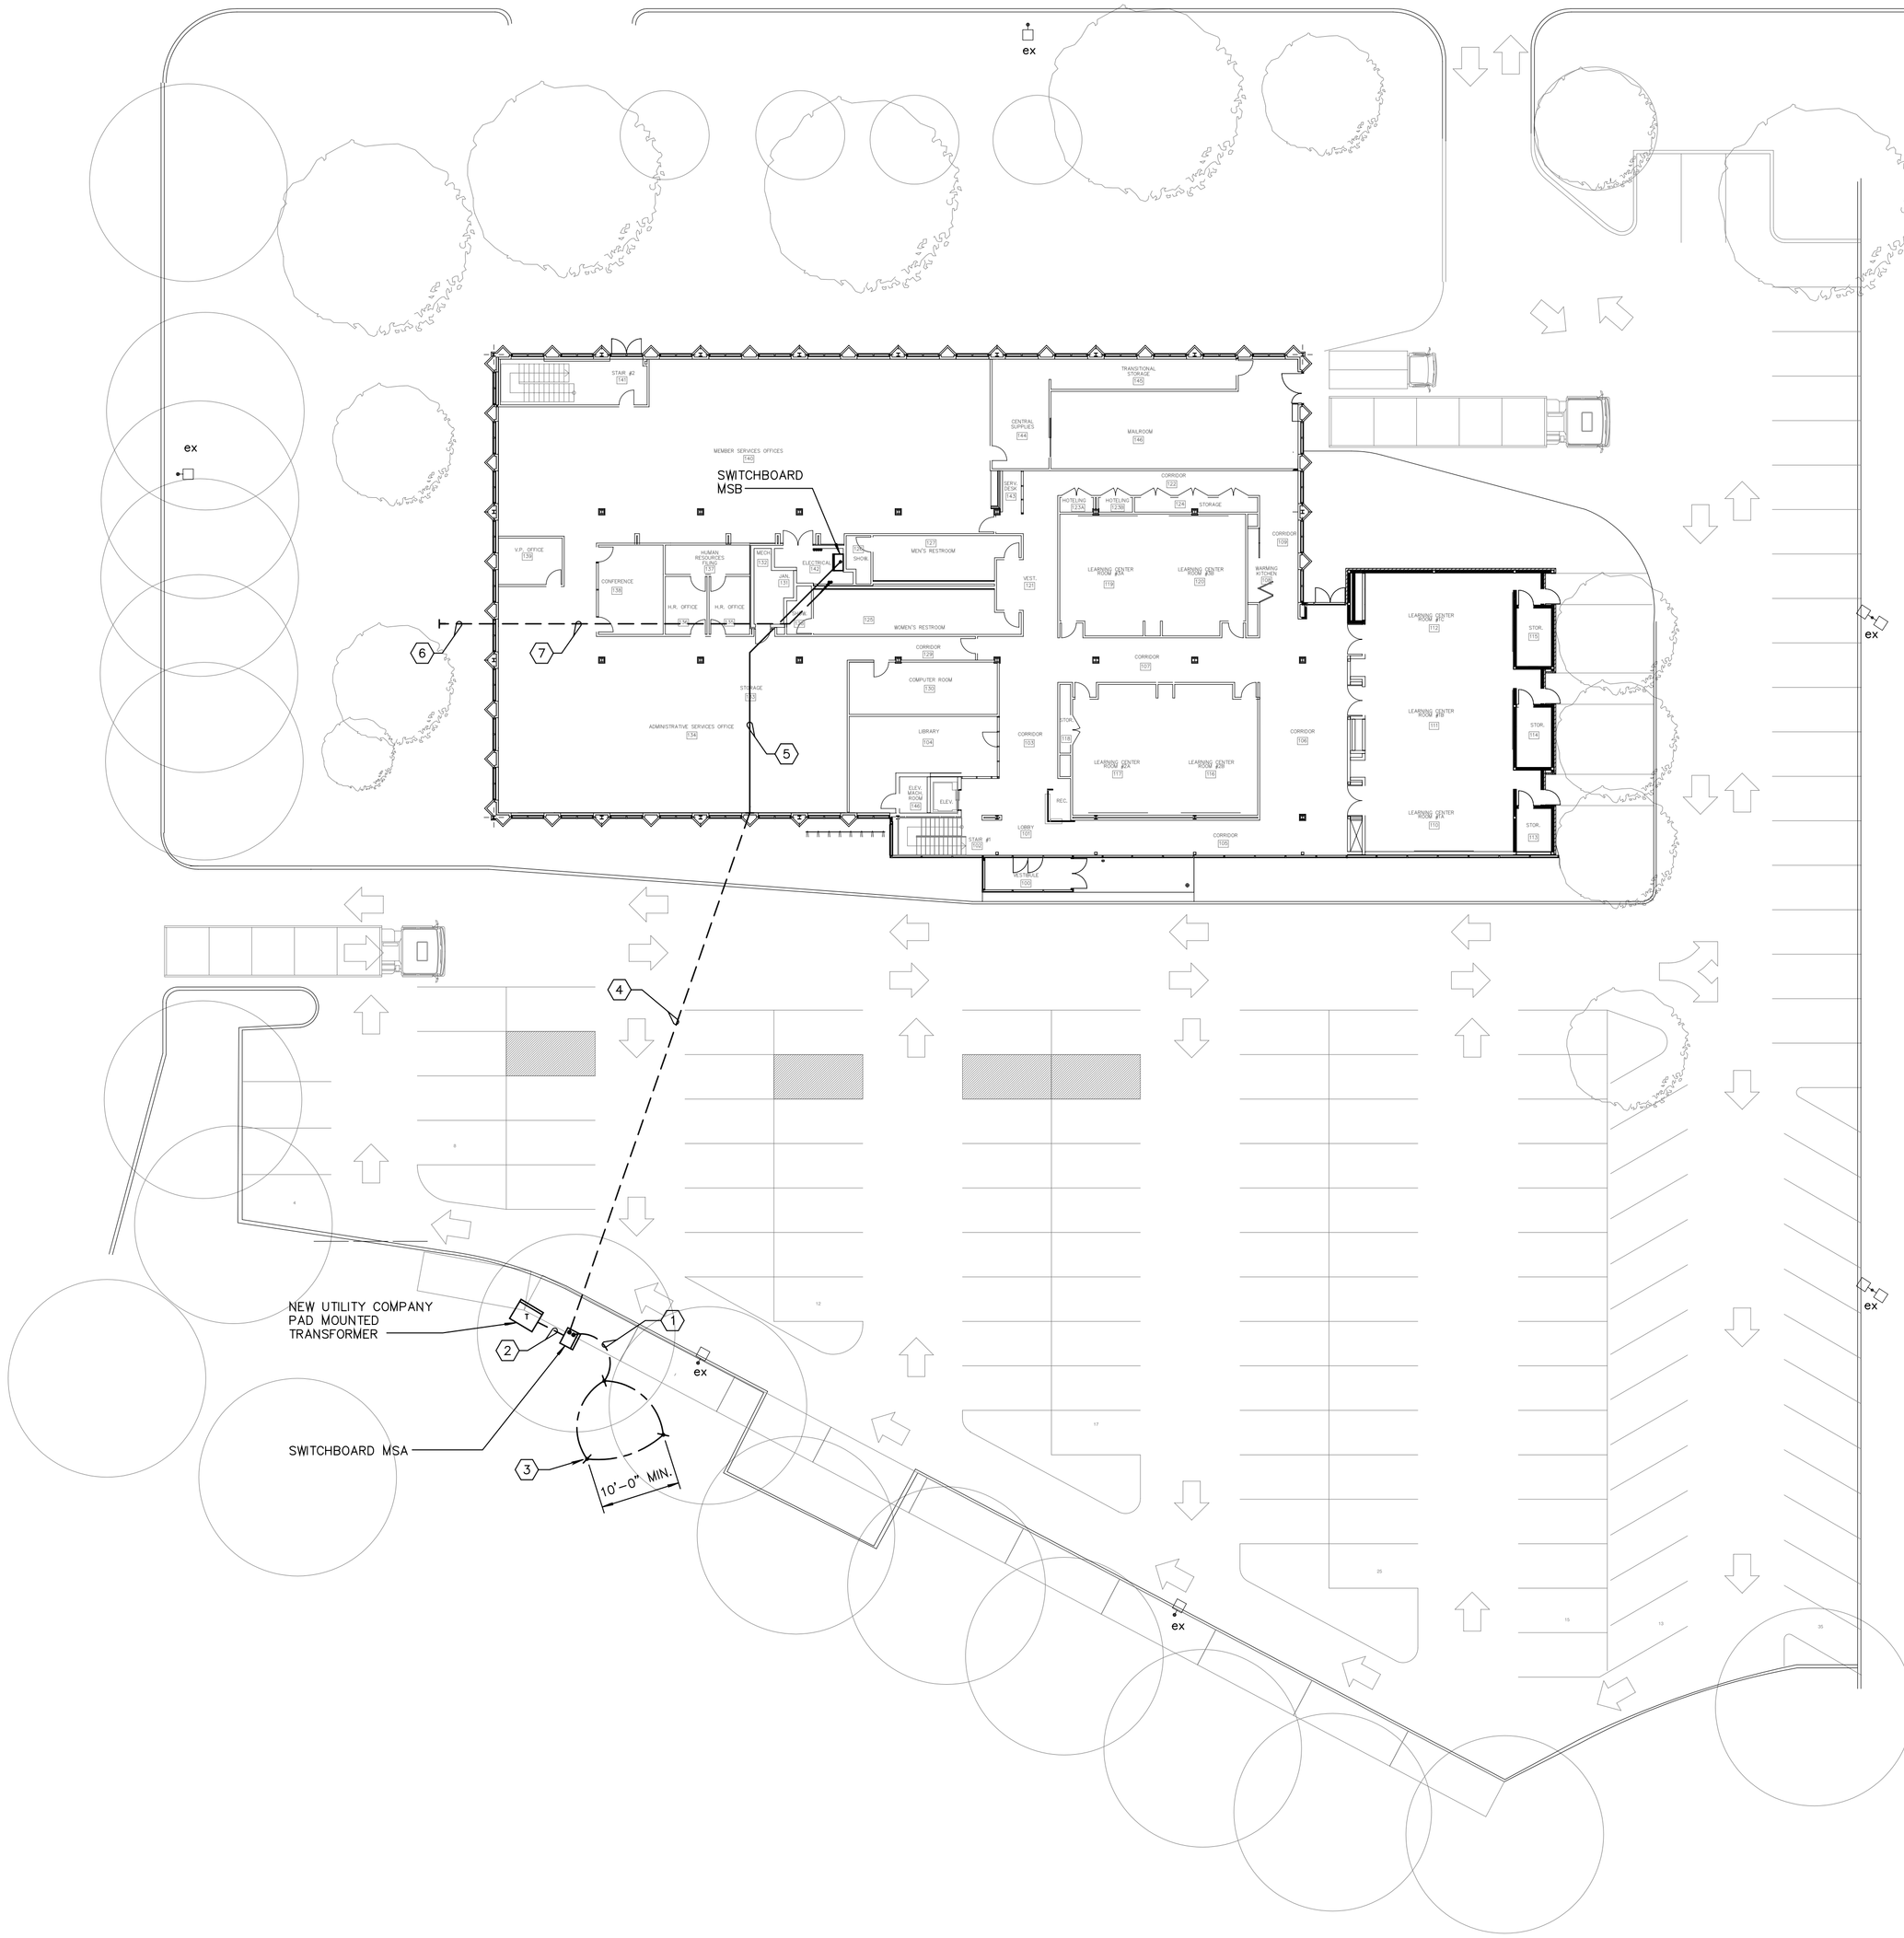

KEYNOTES: (THIS SHEET ONLY)

1. #4/0 BARE COPPER GROUNDING CONDUCTOR.
2. UTILITY SERVICE CONCRETE ENCASED. SEE ONE-LINE DIAGRAM FOR MORE INFORMATION.
3. 10'-0" LONG 3/4" DIAMETER COPPER ROD. CAD WELL TO GROUNDING CONDUCTOR.
4. UNDERGROUND BUILDING FEEDER, CONCRETE ENCASED – SEE ONE-LINE DIAGRAM FOR MORE INFORMATION.
5. BUILDING FEEDER TURNED UP PILASTER AND RUN ABOVE ACCESSIBLE CEILING.
6. (1) 4" CONDUIT WITH INNERDUCT AND PULLSTRINGS STUBBED OUT 5'-0" PAST BUILDING EXTERIOR.
7. (1) 4" CONDUIT WITH INNERDUCT AND PULLSTRING TURNED UP PILASTER AND RUN ABOVE ACCESSIBLE CEILING.

1 / E0.02 **ELECTRICAL SITE PLAN**
SCALE: 1"=20'

NORTH

jeffers engineering associates
270 Scientific Drive
Norcross, Georgia 30092
(770) 447-5970
Technology Park/Atlanta

ASHRAE HEADQUARTERS
ADDITION AND RENOVATION

RICHARD + WITTSCHIEBE
ARCHITECTURE
INTERIORS
PLANNING

© COPYRIGHT
THIS DRAWING IS THE PROPERTY OF RICHARD + WITTSCHIEBE ARCHITECTS, INC. AND IS NOT TO BE USED ON ANY OTHER PROJECT AND SHALL BE RETURNED UPON REQUEST. COPYRIGHT AS DATED RICHARD + WITTSCHIEBE ARCHITECTS, INC. NOT VALID UNLESS SIGNED AND SEALED.

DRAWING TITLE:
ELECTRICAL SITE PLAN

PROJECT NUMBER:
200614

DATE:
05/25/07

DRAWING NUMBER:
E0.02