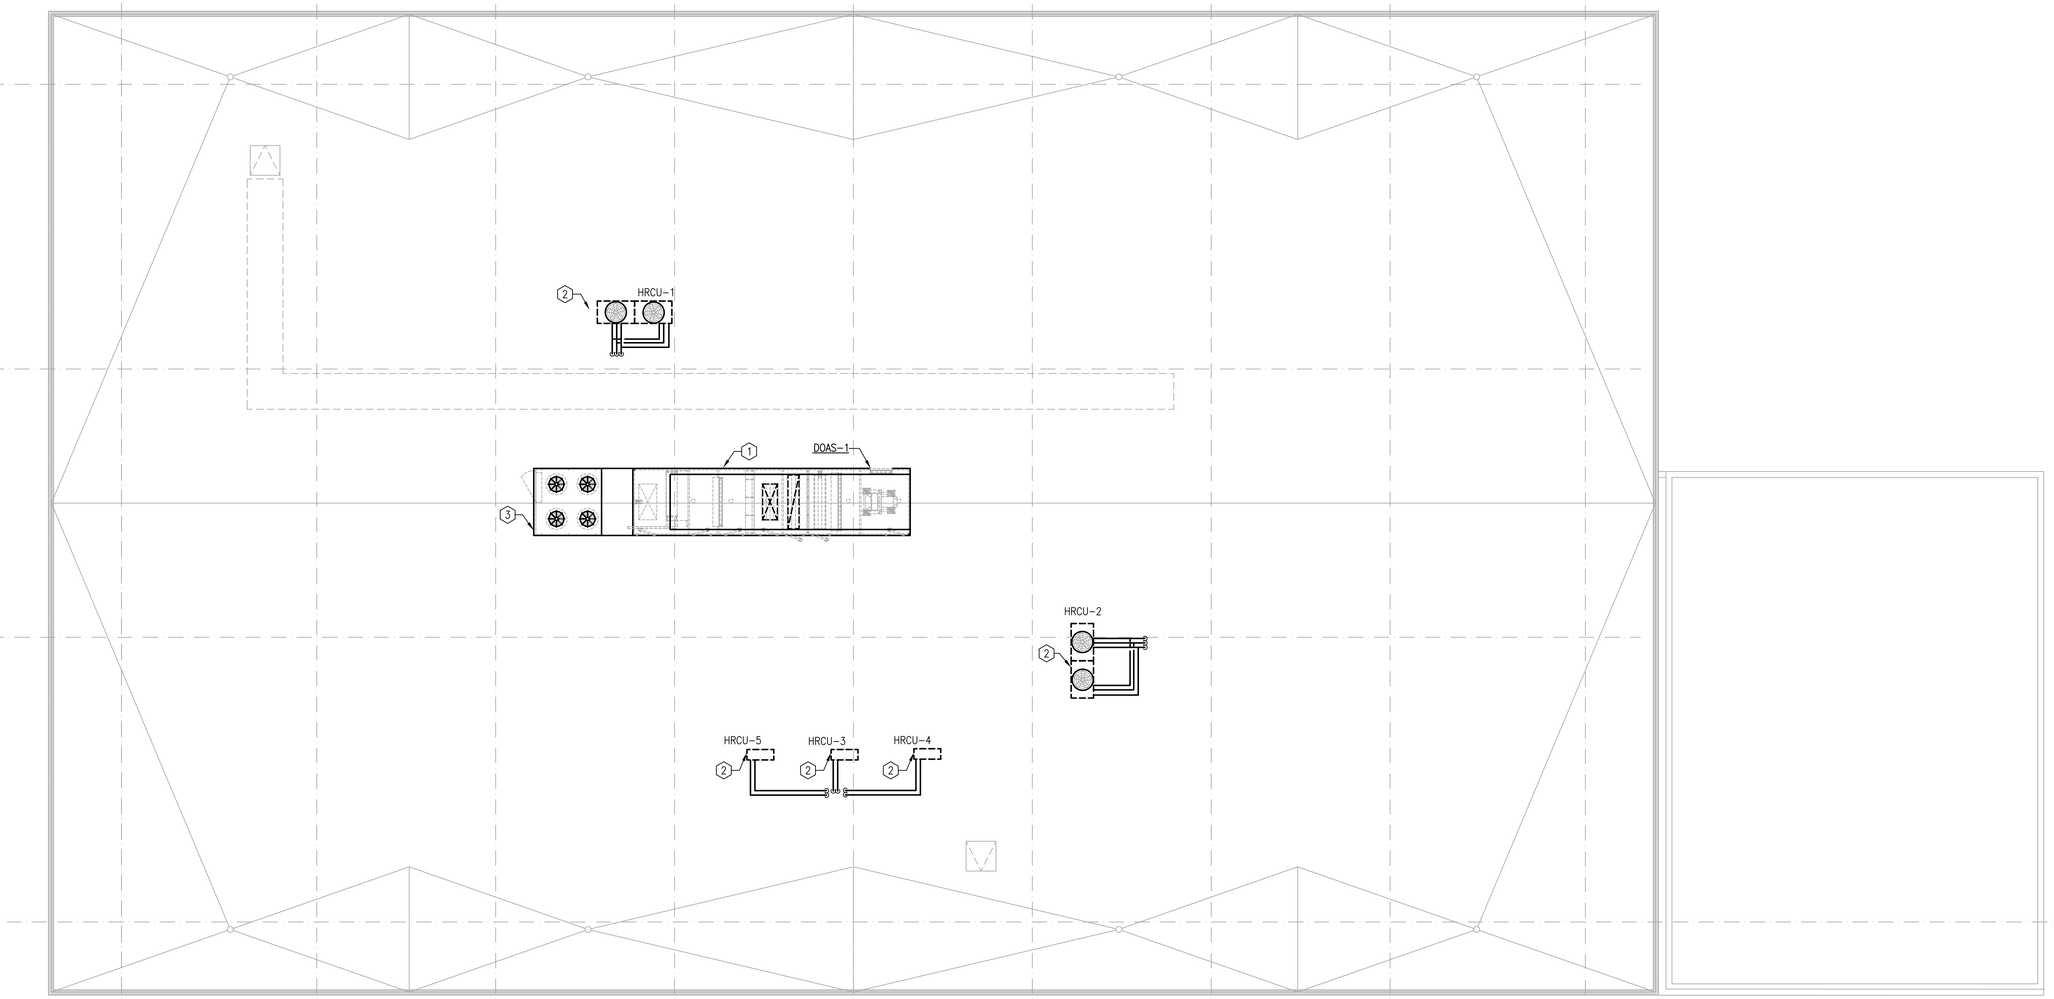

ROOF – HVAC PLAN

SCALE: 1/8 " = 1'-0"

GENERAL NOTES

1. INSTALL EQUIPMENT IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.
2. PROTECT ALL MATERIALS AND EQUIPMENT FROM DAMAGE.
3. SEE SHEET M4.1 FOR SCHEDULE AND CAPACITIES.
4. EXTEND REFRIGERANT PIPING FROM CONDENSING UNITS TO ROOF CAP.

KEY NOTES

1. DEDICATED OUTSIDE AIR SYSTEM (DOAS) UNIT ON ROOF CURB.
2. OUTDOOR VRF HEAT RECOVERY UNIT ON ROOF EQUIPMENT RAILS.
3. AIR-COOLED CHILLER ON ROOF EQUIPMENT RAILS.

PRELIMINARY ONLY
NOT FOR CONSTRUCTION

CONSULTING ENGINEERS
Johnson, Spellman & Associates, Inc.
6991 Peachtree Industrial Boulevard, Building 700,
Norcross, Georgia 30092
Phone (770) 447-4555 Fax (770)246-9042
visit us at www.jsace.com
© 2006 Johnson, Spellman & Associates, Inc.

RICHARD + WITTSCHIEBE

ASHRAE HEADQUARTERS
ADDITION AND RENOVATION

© COPYRIGHT
THIS DRAWING IS THE PROPERTY OF RICHARD + WITTSCHIEBE ARCHITECTS, INC. AND IS NOT TO BE USED ON ANY OTHER PROJECT AND SHALL BE RETURNED UPON REQUEST. ALL REPRODUCTIONS DATED RICHARD + WITTSCHIEBE ARCHITECTS, INC. NOT VALID UNLESS SIGNED AND SEALED.

DRAWING TITLE:
ROOF HVAC PLAN

PROJECT NUMBER:
200614

DATE:
5/25/07

DRAWING NUMBER:
M2.3